



2050

THYRATRON

GAS TETRODE

2050

GENERAL DATA

Electrical:

Heater, for Unipotential Cathode:	<u>Min.</u>	<u>Av.</u>	<u>Max.</u>	
Voltage (AC or DC)	5.7	6.3	6.9	volts
Current, with heater volts = 6.3	0.54	0.60	0.66	amp

Cathode:

Heating Time, prior to				
tube conduction	10	-	-	sec

Direct Interelectrode Capacitances (Approx.):•

Grid No.1 to Anode		0.26	μf
Input		4.2	μf
Output		3.6	μf

Ionization Time (Approx.):

For conditions: dc anode volts = 100; grid-No. 1			
square-pulse volts = 50; and peak anode amp.			
during conduction = 1.0		0.5	μsec

Deionization Time (Approx.):

For conditions: dc anode volts = 125; grid-No. 1			
volts = -250; grid-No. 1 resistor (ohms) =			
1000; dc anode amp. = 0.1		50	μsec

For conditions: dc anode volts = 125; grid-No. 1			
volts = -10; grid-No. 1 resistor (ohms) = 1000;			
dc anode amp. = 0.1		100	μsec

Maximum Critical Grid Current, with ac anode-			
supply volts (rms) = 460, and average anode			
amp. = 0.1		0.5	μamp

Tube Voltage Drop (Approx.)		8	volts
---------------------------------------	--	---	-------

Grid-No.1 Control Ratio (Approx.) with grid-No. 1			
resistor (megohms) = 0; grid-No.2 volts = 0			250

Grid-No.2 Control Ratio (Approx.) with grid-No. 1			
resistor (megohms) = 0; grid-No.2 resistor			
(megohms) = 0; grid-No. 1 volts = 0			800

• without external shield.

Mechanical:

Mounting Position.	Any
----------------------------	-----

Maximum Overall Length	4-1/8"
----------------------------------	--------

Maximum Seated Length.	3-9/16"
--------------------------------	---------

Maximum Diameter	1-9/16"
----------------------------	---------

Bulb	ST-12
----------------	-------

Base	Small-Shell Octal 8-Pin
----------------	-------------------------


Basing Designation for BOTTOM VIEW	6BS
--	-----

Pin 1-No Connection

Pin 2-Heater

Pin 3-Anode

Pin 4-No Connection



Pin 5-Grid No.1

Pin 6-Grid No.2

Pin 7-Heater

Pin 8-Cathode

← Indicates a change.

JUNE 15, 1948

TUBE DEPARTMENT

RADIO CORPORATION OF AMERICA, HARRISON, NEW JERSEY

DATA



2050 THYRATRON

RELAY and GRID-CONTROLLED RECTIFIER SERVICE

Maximum Ratings, Absolute Values:

PEAK ANODE VOLTAGE:

Forward.	180 max.	650 max.	volts
Inverse.	360 max.	1300 max.	volts

GRID-No.2 (SHIELD-GRID) VOLTAGE:

Peak, before anode conduction.	-100 max.	-100 max.	volts
Average, during anode conduction [■]	-10 max.	-10 max.	volts

GRID-No.1 (CONTROL-GRID) VOLTAGE:

Peak, before anode conduction.	-250 max.	-250 max.	volts
Average, during anode conduction [■]	-10 max.	-10 max.	volts

CATHODE CURRENT:

Peak	1.0 max.	1.0 max.	amp
Average [■]	0.2 max.	0.1 max.	amp
Surge, for duration of 0.1 sec. max.	10 max.	10 max.	amp

→ GRID-No.2 CURRENT:

Average [■]	+0.01 max.	+0.01 max.	amp
--------------------------------	------------	------------	-----

→ GRID-No.1 CURRENT:

Average [■]	+0.01 max.	+0.01 max.	amp
--------------------------------	------------	------------	-----

PEAK HEATER-CATHODE VOLTAGE:

Heater negative with respect to cathode.	100 max.	100 max.	volts
Heater positive with respect to cathode.	25 max.	25 max.	volts

AMBIENT TEMPERATURE RANGE.	-75 to +90	-75 to +90	°C
------------------------------------	------------	------------	----

→ Typical Operating Conditions for Relay Service:

RMS Anode Voltage.	117 . .	400 . .	volts
Grid-No.2 Voltage.	0 . .	0 . .	volts
RMS Grid-No.1 Bias Voltage	5 [□] . .	- . .	volts
DC Grid-No.1 Bias Voltage.	- . .	-6 . .	volts
Peak Grid-No.1 Signal Voltage.	5 . .	6 . .	volts
Grid-No.1-Circuit Resistance	1.0 . .	1.0 . .	megohm
Anode-Circuit Resistance [#]	1200 . .	2000 . .	ohms

Maximum Circuit Values:

Grid-No.1-Circuit Resistance:

For average anode current below 0.1 amp.	10 max.	megohms
For average anode current above 0.1 amp.	2 max.	megohms

■ Averaged over any interval of 30 sec. max.

□ Approximately 180° out of phase with the anode voltage.

* Sufficient resistance, including the tube load, must be used under any conditions of operation to prevent exceeding the current ratings.


→ Indicates a change.



2050

2050

AVERAGE CONTROL CHARACTERISTICS

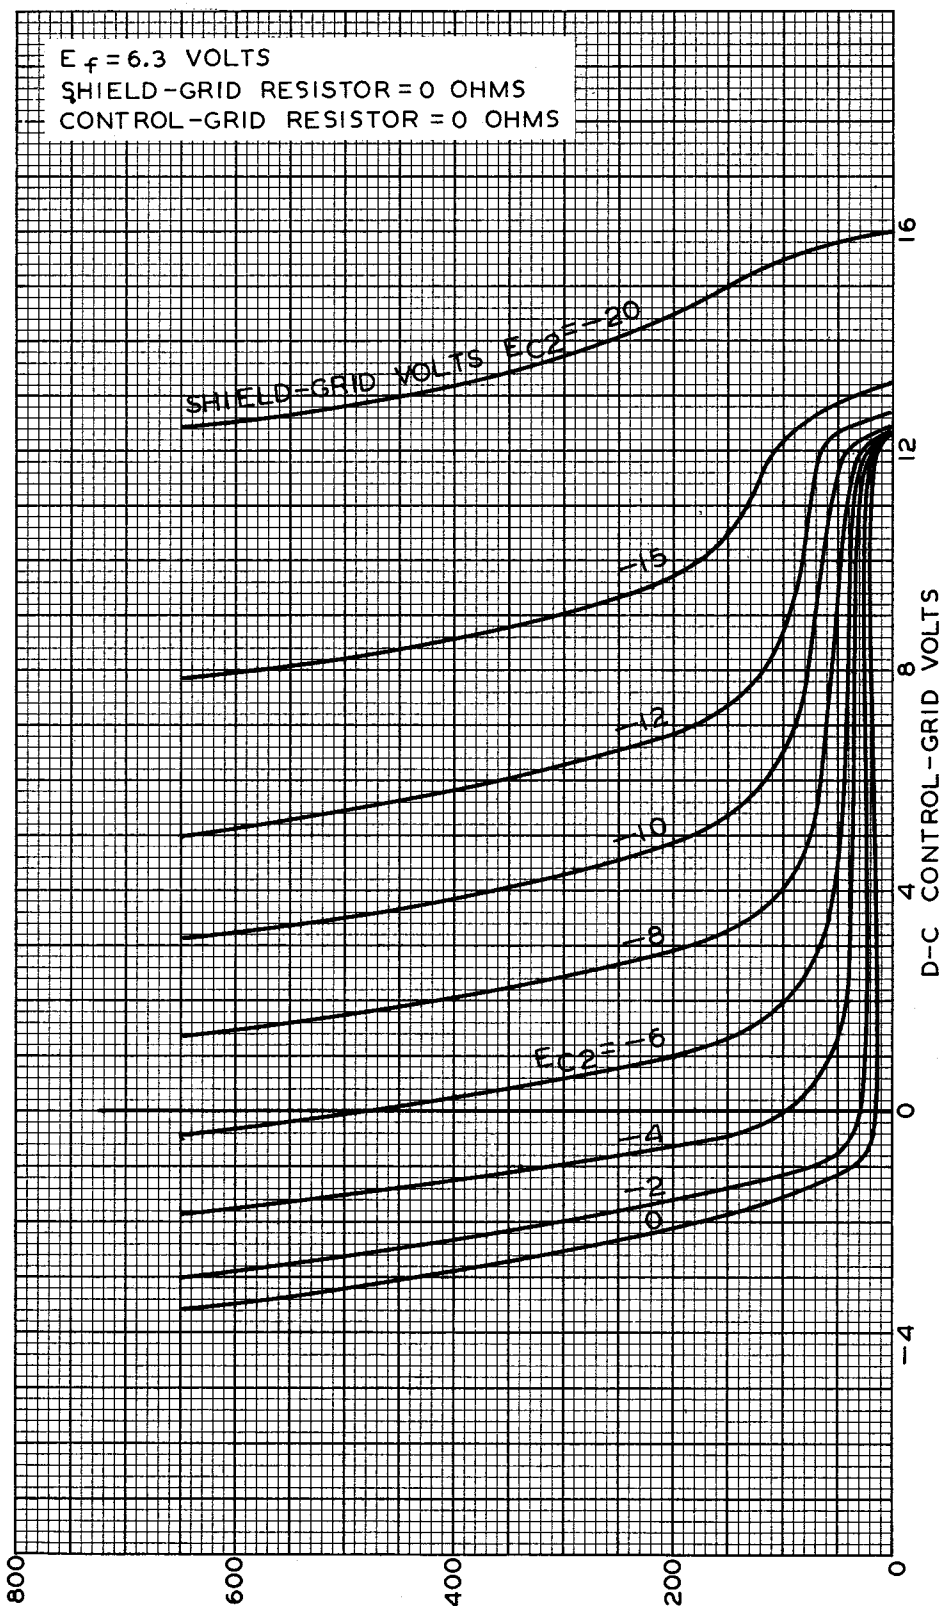

MAY 3, 1944

D-C ANODE VOLTS
RCA VICTOR DIVISION
RADIO CORPORATION OF AMERICA, HARRISON, NEW JERSEY

92CM-6274R1


2050




2050

THYRATRON

AVERAGE GRID CHARACTERISTICS
DURING ANODE CONDUCTION

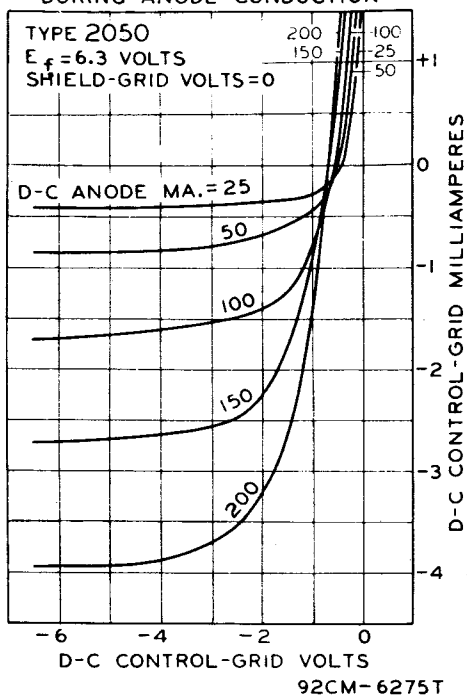

AVERAGE GRID CHARACTERISTICS
BEFORE ANODE CONDUCTION

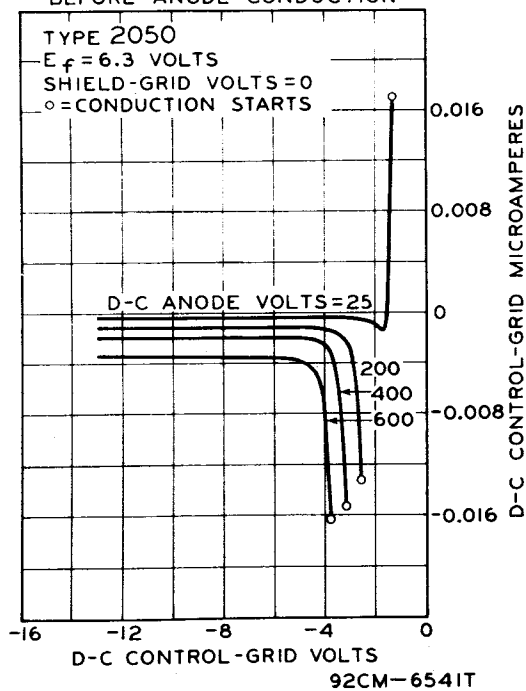

APRIL 1, 1944

RCA VICTOR DIVISION
 RADIO CORPORATION OF AMERICA, HARRISON, NEW JERSEY

92CM-6275T
 92CM-6541T



2050

2050 THYRATRON

OPERATIONAL RANGE OF CRITICAL GRID VOLTAGE

