



1946

1946 VACUUM-GAUGE TUBE

THERMOCOUPLE TYPE

DATA**General:**

Heater, for Thermocouple:

Voltage (Approx.) 1 ac or dc volts

Current 0.070 amp

Resistance of Thermocouple 5 approx. ohms

Maximum Overall Length (with tubulation) 6-1/4"

Maximum Diameter 1-11/16"

Bulb T-12

Tubulation 3/8" Diameter Hard Glass,
Corning Code 772 Nonex


Mounting Position Any

Terminal Arrangement See Outline Drawing


Terminal Connections:

H - Heater

TC - Thermocouple

**Calibration:**

See next page.

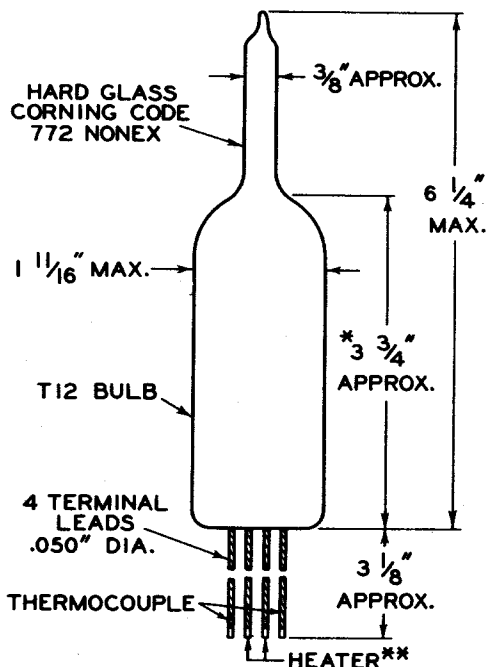

* MEASURED FROM BULB END TO BULB-TOP LINE AS DETERMINED BY RING GAUGE OF 1/2" I.D.

** BROWN HEATER LEAD SHOULD BE CONNECTED TO POSITIVE TERMINAL OF DC HEATER SUPPLY. 92CS-6815

JUNE 20, 1947

TUBE DEPARTMENT

TENTATIVE DATA

RADIO CORPORATION OF AMERICA, HARRISON, NEW JERSEY

1946





1946

CALIBRATION CURVES

CURVE	HEATER		
	BROWN LEAD	UNMARKED LEAD	CURRENT AMP.
1	+	-	0.070 DC
2	-	+	0.070 DC
3	±	±	0.070 RMS

GAS= DRY AIR
TO CONVERT MM TO MICRONS,
MULTIPLY VALUES BY 1000

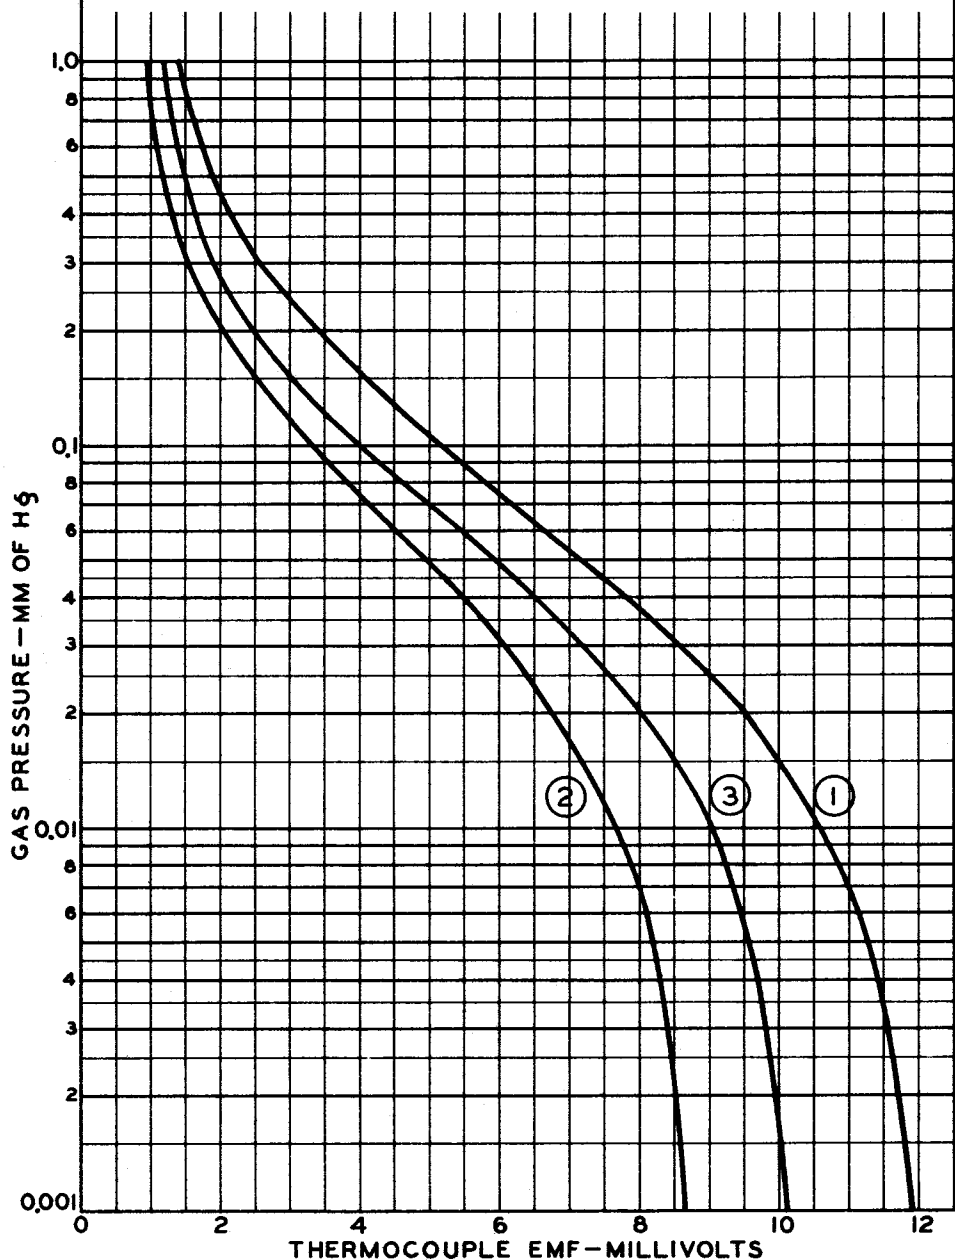

MAR. 11, 1947

TUBE DEPARTMENT
RADIO CORPORATION OF AMERICA, HARRISON, NEW JERSEY

92CM-6852